
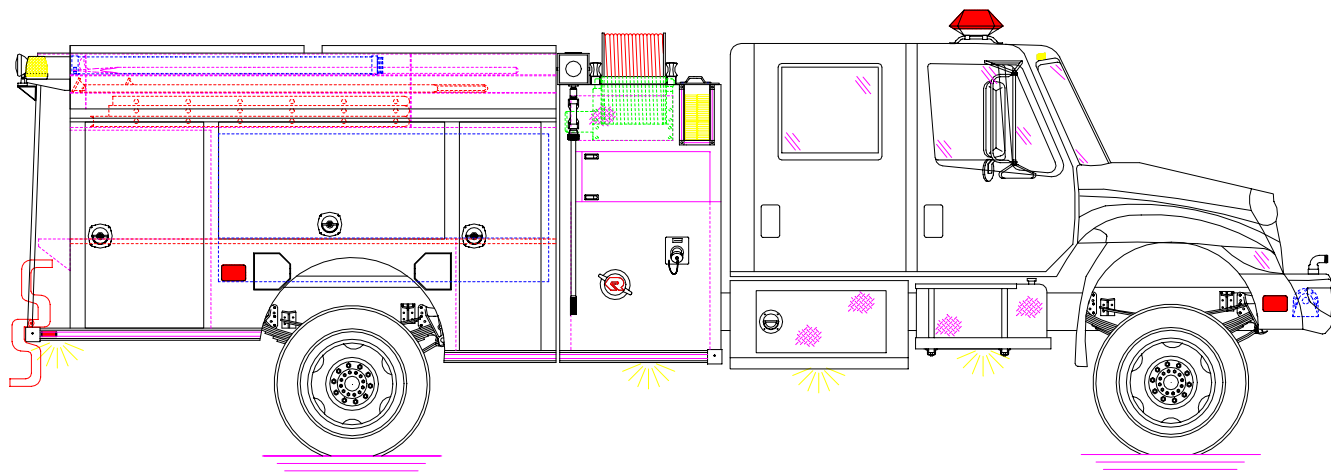
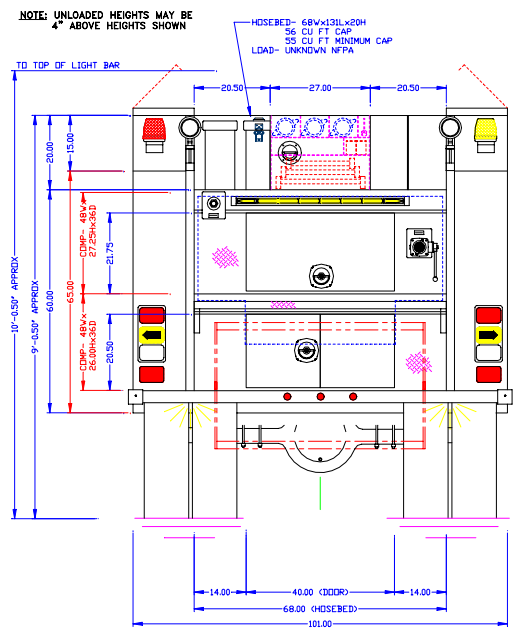


APPROVED BY:

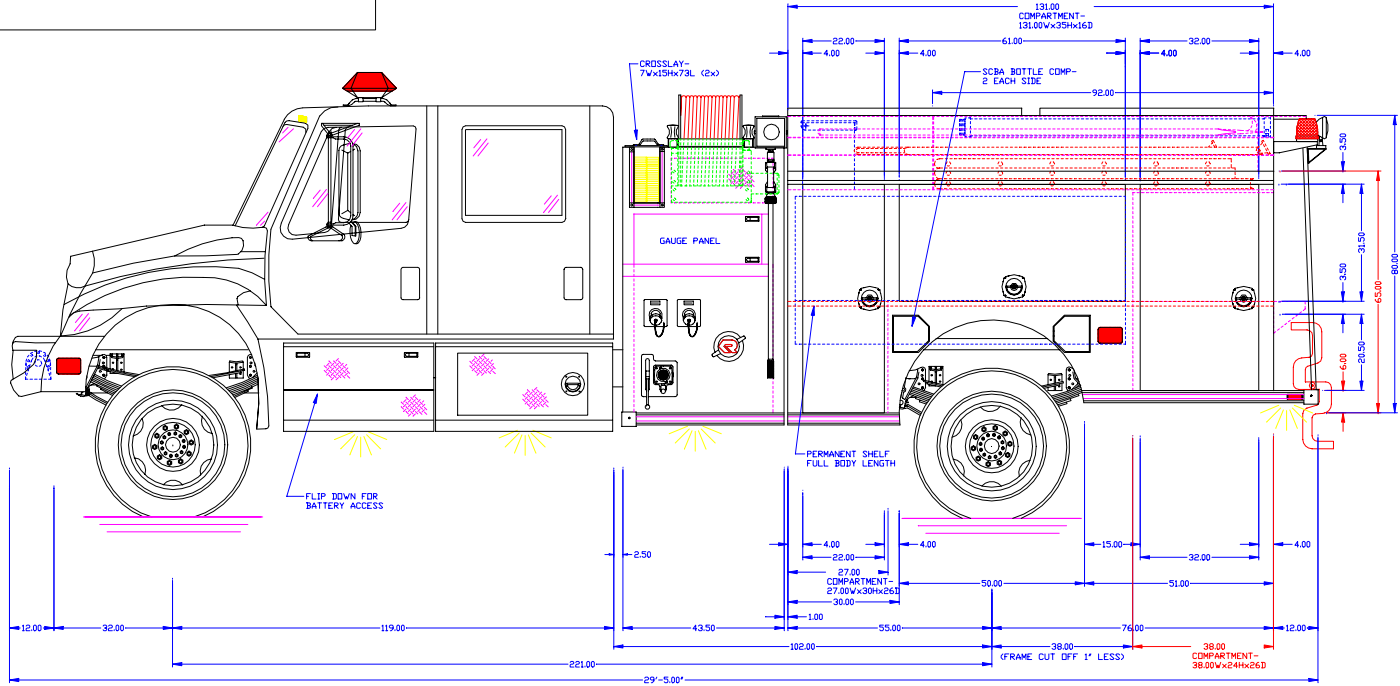

JOB # 13599
 OK
 SAD
 12-27-05

- NOTE: TANK CAP- 750 GAL POLYPROPYLENE
- 20 GAL CAP POLYPROPYLENE FDM CELL (1x)
- PUMP CAP- 750 GPM WATERJUS
- DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS DURING CONSTRUCTION
- NOT ALL ITEMS IN SPECS ARE SHOWN ON THIS PRINT
- SPOT LIGHT- 2 IN REAR
- COMPARTMENT INTERIORS SPRAY LINER
- SIDE PUMP PANELS BLACK THERMOPLASTIC
- NFPA UPPER LIGHT PACKAGE- CODE 3
- NFPA LOWER LIGHT PACKAGE- CODE 3
- REAR INTERMEDIATE STEP TO BE BOLT ON

NONE	MAXIMUM HEIGHT	19'11"	19'11"	SAD	19'11"	SAD
NONE	MAXIMUM LENGTH	101'	101'	SAD	101'	SAD
101'	BODY WIDTH	FIRELINE				

rosenbauer
 LEGGETT VALLEY FPD., CA
 PRODUCTION DRAWING

0 12" 24" SCALE: REF. ONLY