APPROVED BY:

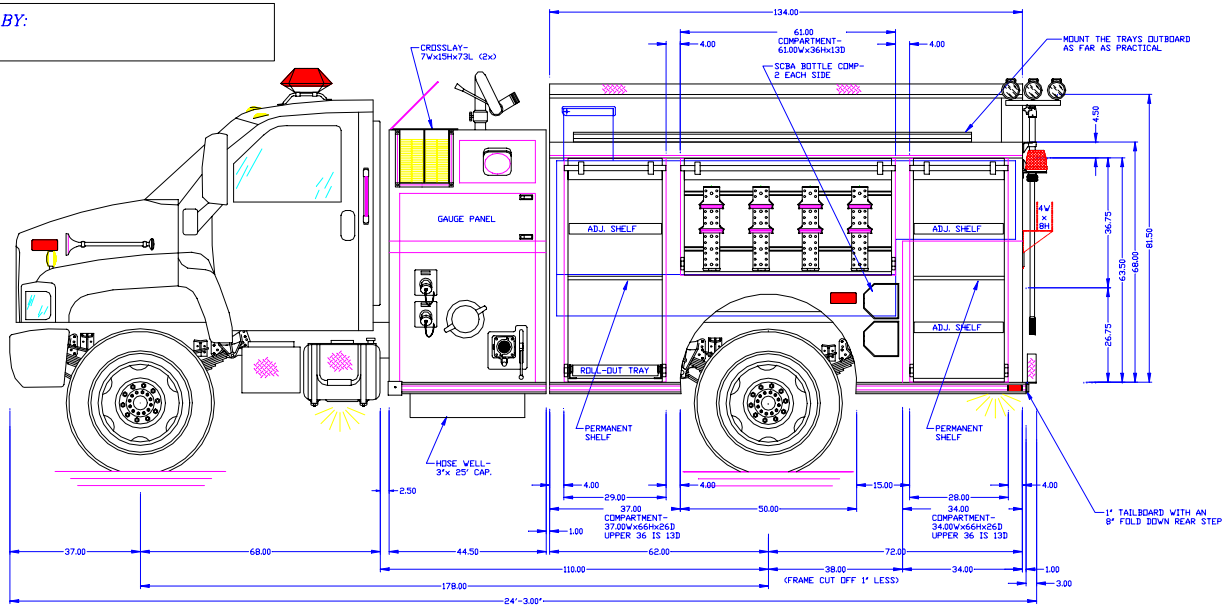

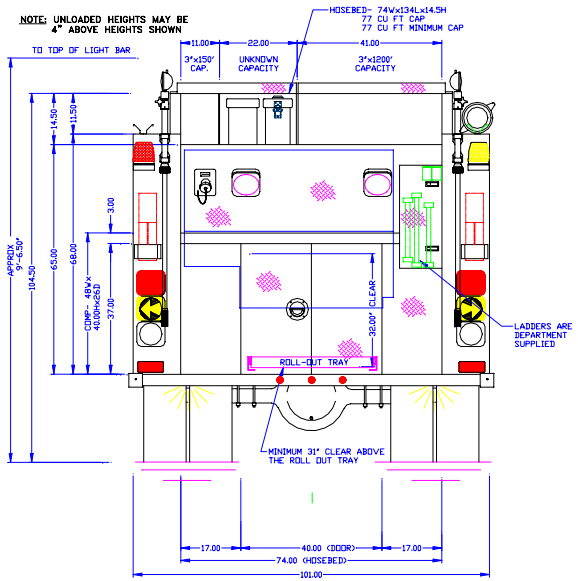

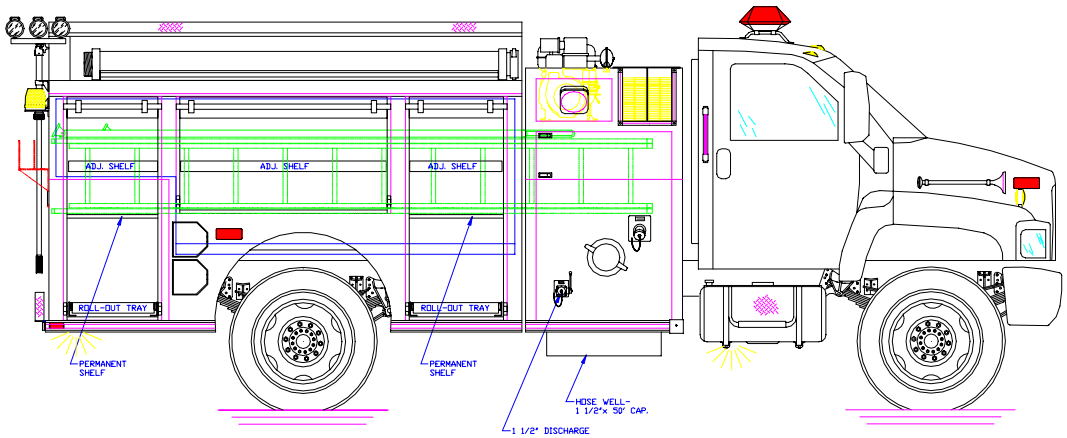

NOTE: TANK CAP- 1000 GAL POLYPROPYLENE
20 GAL CAP FOAM CELL IN MAIN TANK (1x)
PUMP CAP- 1250 GPM
AUX. PUMP- DARLEY 1-1/2 AGE 21 LD
DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS DURING CONSTRUCTION
NOT ALL ITEMS IN SPECS ARE SHOWN ON THIS PRINT
SPOT LIGHT- 2 ON REAR
COMPARTMENT INTERIORS SWIRL FINISH
SIDE PUMP PANELS STAINLESS STEEL
TELE LIGHT- 12V FIRE RESEARCH LTA-530-TC - 1 PER SIDE AT PUMP COMPARTMENT
NFPA UPPER LIGHT PACKAGE- CODE 3
NFPA LOWER LIGHT PACKAGE- CODE 3
DEPARTMENT SUPPLIED ALCO-LITE LADDERS:
- 24' 2-SECTION
- 14' ROOF
- 10' ATTIC
ROLL UP DOOR EFFECTIVE OPENING- 3" NARROWER AND 5" SHORTER THAN ACTUAL OPENING IN BODY

JOB # 13335
OK
SAO
04-11-05

NOTE: 68"H SIDE COMPARTMENTS

119"	MAXIMUM HEIGHT	DFTM SAO DATE 07-26-04	DFTM SAO REVISED 12-20-04	DFTM SAO REVISED 04-11-05
24' 11"	MAXIMUM LENGTH	SST FIRELINE		
95"	BODY WIDTH			

rosenbauer

ANDERSON VALLEY V.F.D., CA.

0 12" 24" SCALE: REF. ONLY

DRAWING NUMBER ander5ca

Fire Trucks West
3893 Oxbow Avenue
Boise, ID 83713
(208) 321-0847